

SPECIFICATIONS

HVLS FANS
 MODEL: TBD
 QTY: TBD
 VOLTAGE: TBD
 OPTIONS: Std Mount

CONTROL PANEL
 To house & interconnect the following:
 CONTROL PANEL: HVLS CONTROL
 QTY: TBD
 ENCLOSURE SIZE: TBD
 VOLTAGE: TBD
 OPTIONS: Remote wall mount control
 Nema 1

REVIEW DRAWING
 THIS DRAWING IS NOT INTENDED FOR CONSTRUCTION.
 PLEASE CONSULT WITH REGISTERED ARCHITECT OR PROFESSIONAL ENGINEER FOR ALL LOADS ANALYSIS AND SPECIFICATIONS CONFORMANCE.


ENTREMATIC
 1612 Hulton Drive, Suite 140
 Carrollton, TX 75006

General Notes

The information contained herein is property and confidential to Afront Engineered Solutions, and is to be used solely for the express purpose of the project described herein. It is not to be reproduced, stored in a retrieval system, or transmitted in any form or by any means, electronic, mechanical, photocopying, recording, or by any information storage and retrieval system, without the prior written permission of Afront Engineered Solutions. Afront Engineered Solutions reserves the right to incorporate product improvements without prior notice.

NOTES:
 1) BUILDING STRUCTURE MUST BE SUFFICIENT TO SUPPORT THE FAN INSTALLATION. CONSULT A REGISTERED ARCHITECT OR PROFESSIONAL ENGINEER.
 2) ELECTRICAL CONTRACTOR SHALL ENSURE THAT ALL ELECTRICAL WORK MEETS LOCAL ELECTRICAL CODES.
 3) ELECTRICAL DISCONNECT AND FUSING PROVIDED BY OTHERS.
 4) GENERAL CONTRACTOR SHALL ENSURE EQUIPMENT INSTALLATION MEETS ALL APPLICABLE BUILDING CODES.
 5) STANDARD MOUNT ACCOMMODATES 5' BAY INSTALLATION. FOR GUIDED MOUNTING, PLEASE NOTE ON ORDER.
 6) STANDARD VOLTAGES: 208-480V SINGLE PHASE, 208 - 480 THREE PHASE.
 7) VFD CONTROL PANEL, INTERNALLY MOUNTED ON MOTOR, LOCATED ON FAN HOUSING.
 8) STANDARD INSTALLATION INCLUDES ONE REMOTE PER FAN AND TWO 100 FT ETHERNET CABLES.
 9) OPTIONAL NETWORK INSTALLATION INCLUDES ONE TOUCHSCREEN WORKSTATION KIT.
 10) NOTE: THE INSTALLATION OF HVLS FANS IN BUILDINGS EQUIPPED WITH "WETTER" SPRINKLERS SHOULD COMPLY WITH THE FOLLOWING:
 (A) THE HVLS FAN SHALL BE CENTERED APPROXIMATELY BETWEEN FOUR ADJACENT SPRINKLERS.
 (B) THE SPARKING CLEARANCE FROM THE FAN TO THE SPRINKLER DEFLECTOR SHALL BE A MINIMUM OF 3 FT (0.9M).
 (C) ALL HVLS FANS SHALL BE INTERLOCKED TO SHUT DOWN IMMEDIATELY UPON RECEIVING A HAZARDOUS SIGNAL FROM THE ALARM REQUIREMENTS OF NFPA 72.

SITE INFORMATION

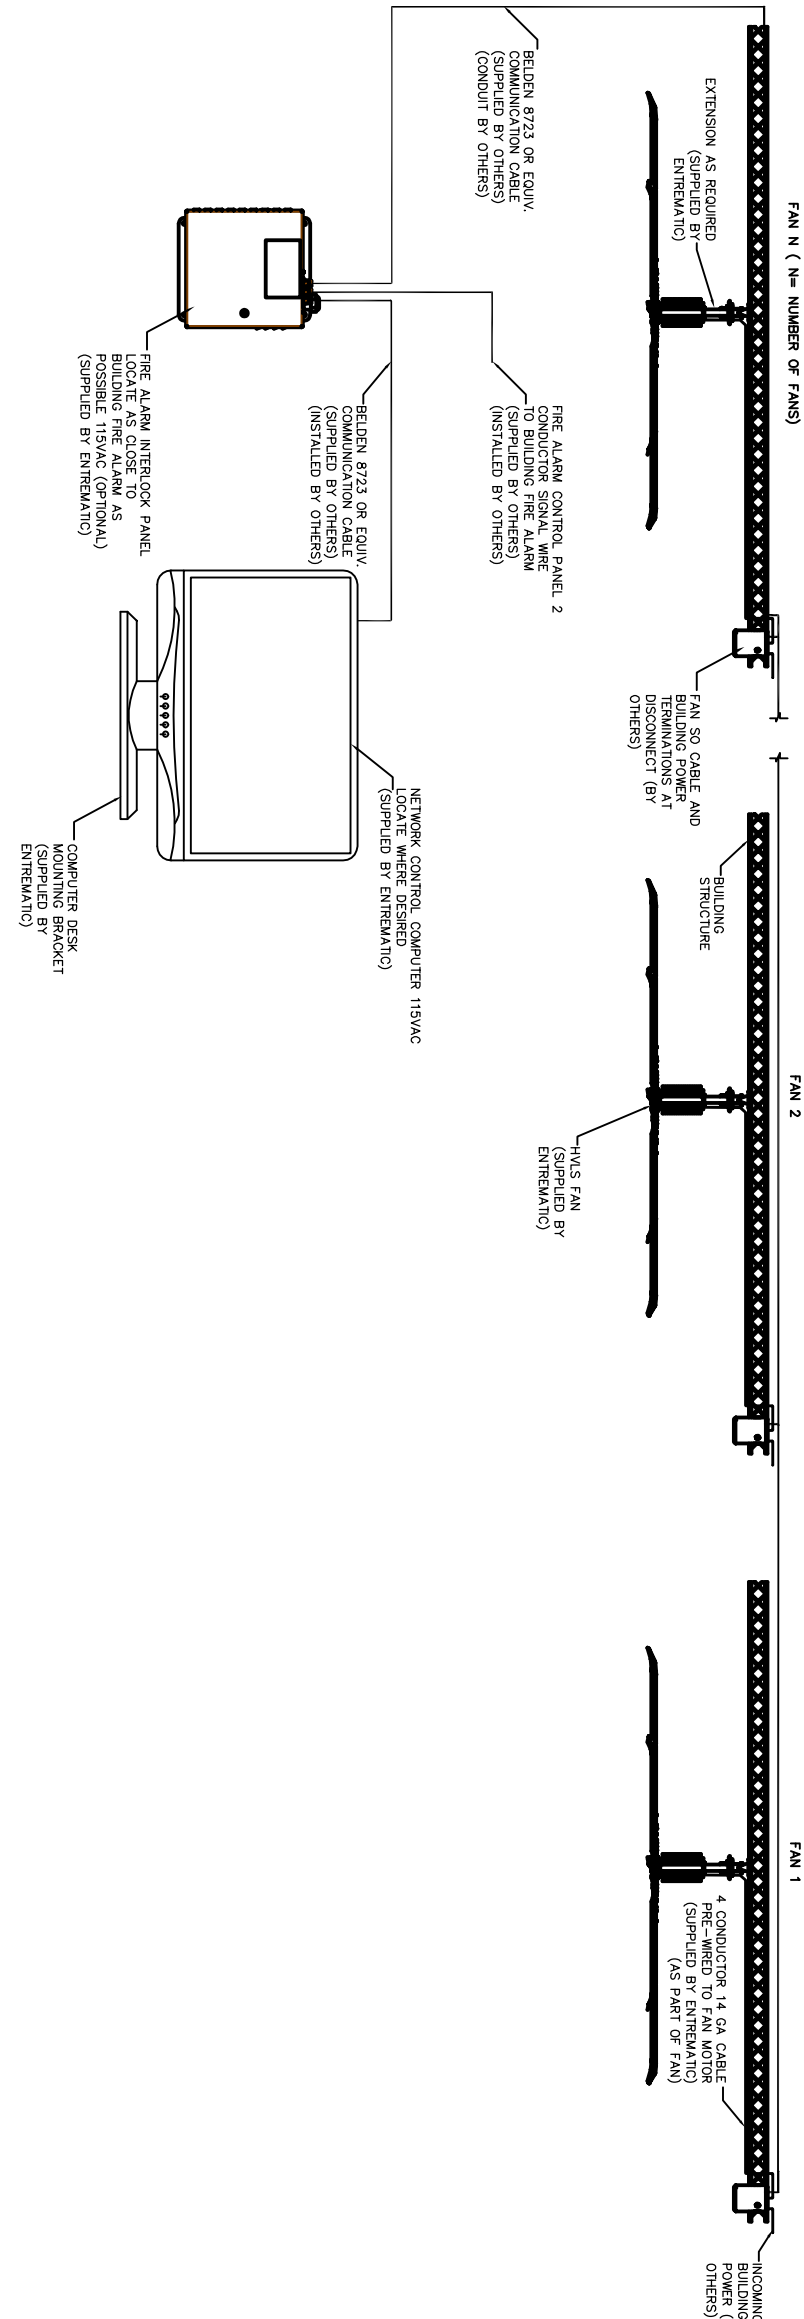

IFAN FIRE CONTROL AND DAISY CHAIN

Revision	Date	Reference	Description	Revision	Date	Reference	Description
-	-	-	-	-	-	-	-
<p>Project Name and Address End User: CUSTOMER NAME Address: TBD</p> <p>Drawn By: HMC/CMH Date: 6/25/15 Scale: NTS</p> <p>Regional Sales Manager: TBD Drawing Number: XXXXX Sheet Number: 1 OF 1</p>							